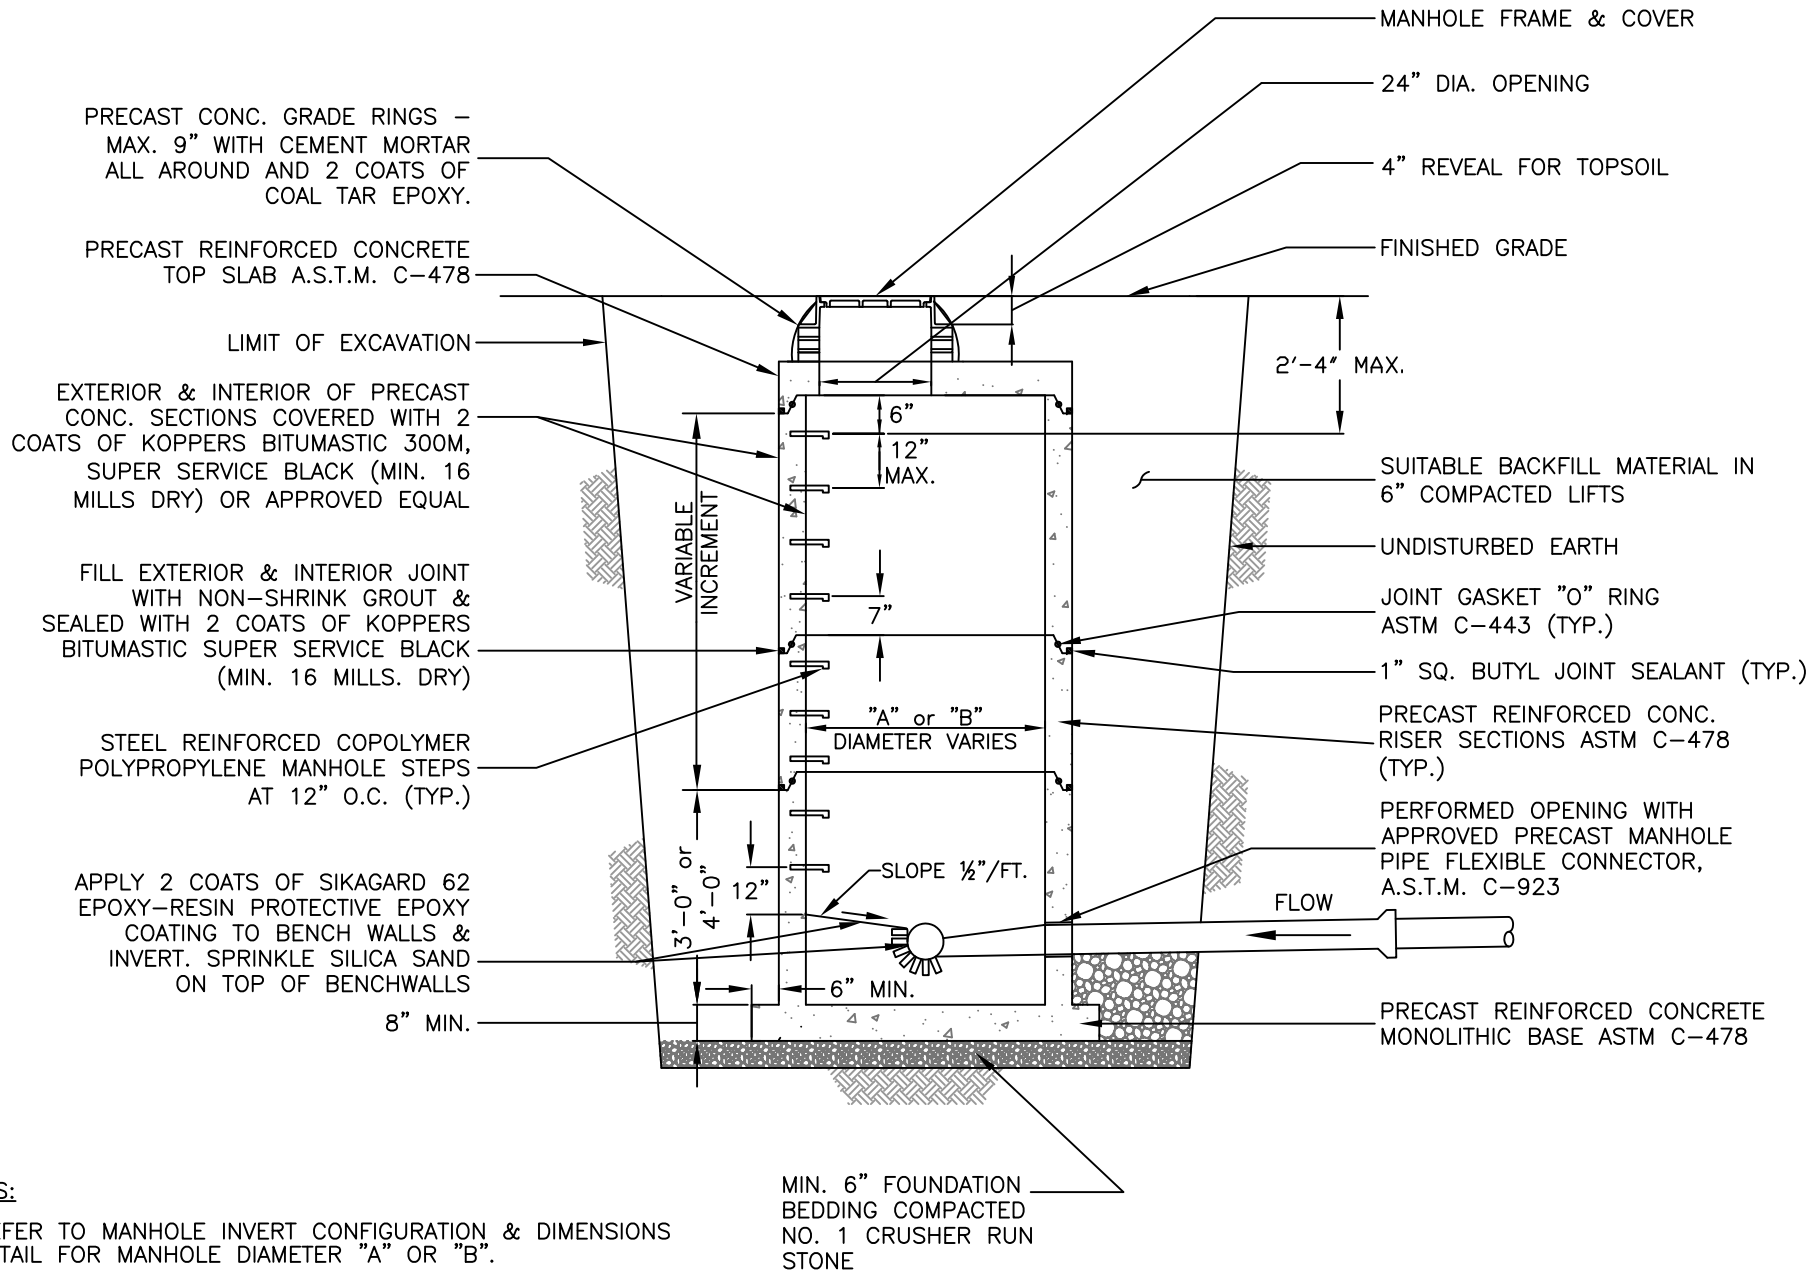

NOTES:

1. REFER TO MANHOLE INVERT CONFIGURATION & DIMENSIONS DETAIL FOR MANHOLE DIAMETER "A" OR "B".
2. ALL DETAILS LISTED APPLY TO BOTH TYPES OF MANHOLES.
3. PRECAST CONC. MANHOLE WALL & SLAB MINIMUM THICKNESS

MANHOLE DIAMETER	4FT.	5FT.	6FT.
A. TOP SLAB	8"	8"	8"
B. RISER WALL	5"	6"	7"
C. BOTTOM SLAB	8"	8"	8"

4. MAXIMUM DISTANCE BETWEEN MANHOLES SHALL BE 400 FEET.

TOWN OF HENRIETTA

SANITARY MANHOLE DETAIL

SCALE: N.T.S.

DATE: 11/15/2011

SA-08

\\Oserver\user folders\Town Projects\AutoCAD Projects\Non-Town Wide\Details\Sanitary\(SA-08)SanitaryManholeDetail.dwg